



Wels, May 17<sup>th</sup> 2017

## LOW VOLTAGE FAULT RIDE THROUGH (LVRT) REQUIREMENTS IN ROMANIA

**Fronius International GmbH**


hereby confirms that the inverters

/ **Fronius Eco 25.0-3-S**

/ **Fronius Eco 27.0-3-S**

meet the requirements for Low Voltage Fault Ride Through (LVRT) of the grid operator "Compania Nationala de Transport al Energiei Electrice (CNTEE) Transelectrica S.A.".

### LVRT capability Fronius Eco 25.0-3-S/Eco 27.0-3-S

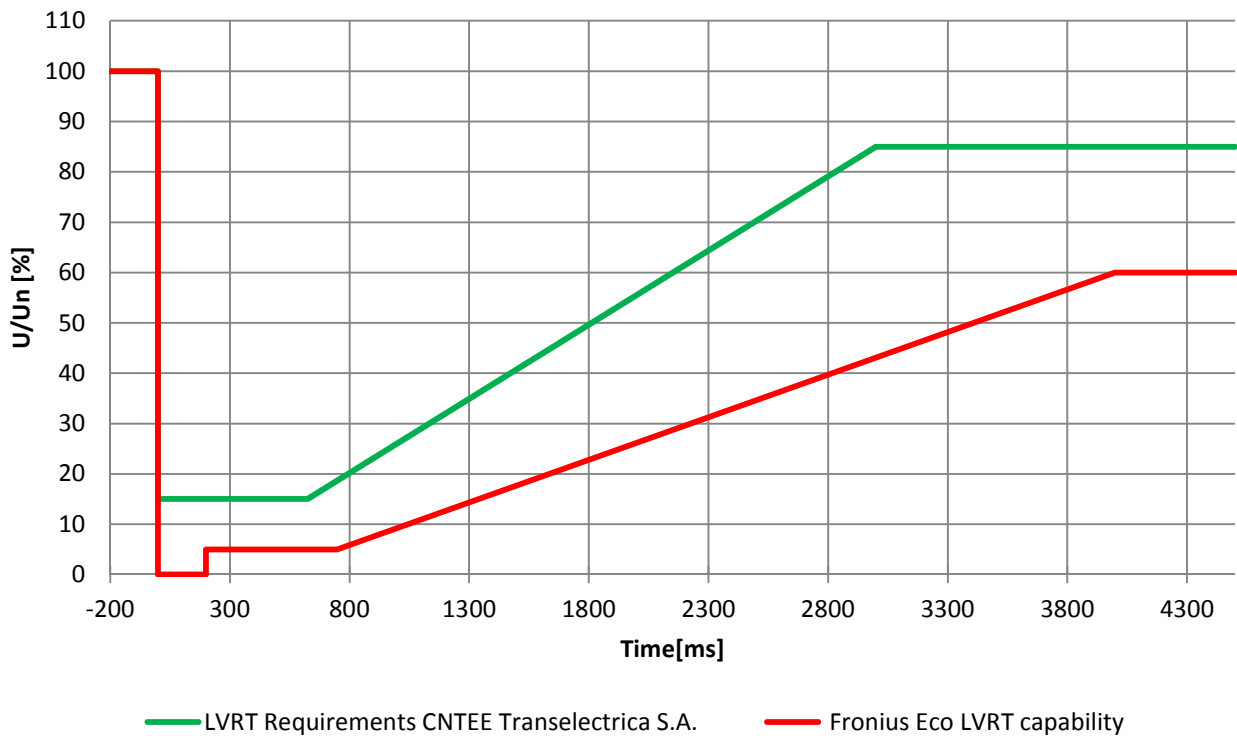

DI Thomas Mühlberger  
Head of Solution Management